



# TOWNSHIP OF SPRING

## Department of Public Safety Fire Marshal's Office

BERKS COUNTY, PA  
2850 WINDMILL RD.  
READING, PA 19608  
Tel. (610) 678-5393  
ext 1360  
Fax. (610) 678-4571  
thatt@springtwpberks.org

## PRIVATE FIRE HYDRANTS

The 2018 International Fire Code Section 507  
NFPA 22, 24, 25, 291

Private Fire Hydrants, Private Fire Service Mains, and Private Water Tanks shall be periodically inspected, tested and maintained in accordance with NFPA 25.


Inspected annually and after each operation – flow test and maintenance done annually

Fire Service Main Piping shall be inspected annually on exposed areas and a flow test shall be performed every 5 years.

Records of inspections, testing and maintenance shall be maintained and added into the Brycer Compliance Engine Software

Unobstructed access to fire hydrants shall be maintained at all times. A 3-foot clear space shall be maintained around the circumference of the fire hydrant at all times.

Additional: All fire hydrants shall have 5-inch Stortz adaptors installed on the large discharge

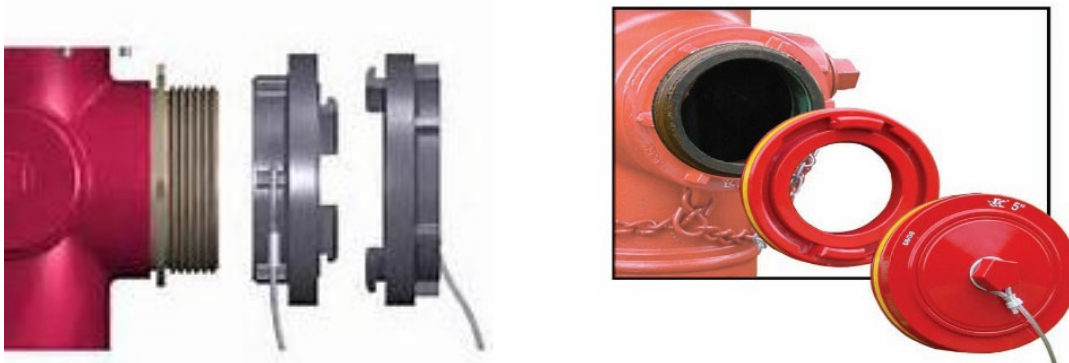

All fire hydrants shall have the bonnet painted to the NFPA color for flow.

- RED – below 500 GPM
- ORANGE – 500 – 999 GPM
- GREEN – 1000 – 1499 GPM
- BLUE – 1500 GPM or more